


SLIT AND BUTT TARGET PATCH CORNERS AS NECESSARY TO FIT DRAIN SUMP (MAXIMUM SLIT LENGTH = 6 INCHES)

LEADER PIPE

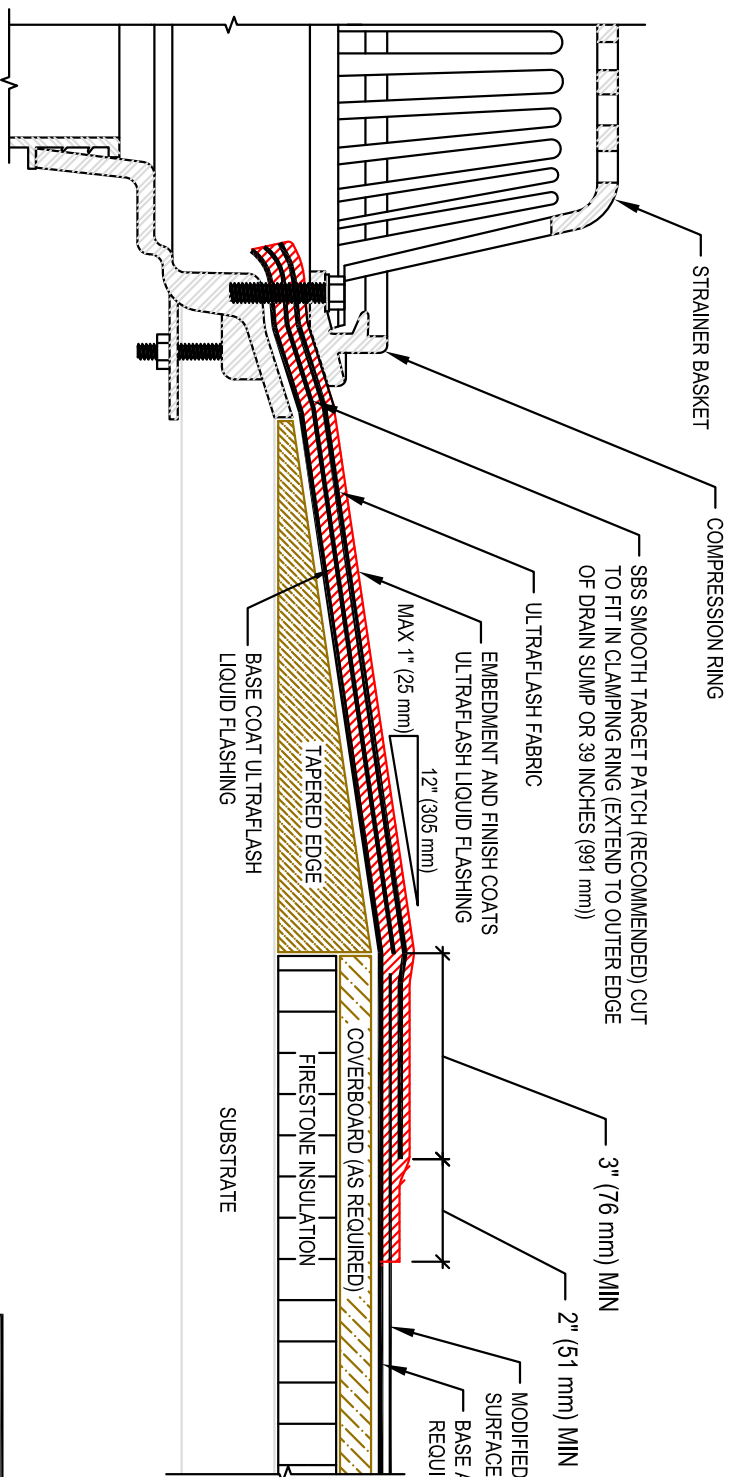

STRAINER BASKET

COMPRESSION RING

SBS SMOOTH TARGET PATCH (RECOMMENDED) CUT TO FIT IN CLAMPING RING (EXTEND TO OUTER EDGE OF DRAIN SUMP OR 39 INCHES (991 mm))

ULTRAFLASH FABRIC

EMBEDMENT AND FINISH COATS

ULTRAFLASH LIQUID FLASHING

MAX 1" (25 mm)

12" (305 mm)

TAPERED EDGE

BASE COAT ULTRAFLASH

LIQUID FLASHING

3" (76 mm) MIN

2" (51 mm) MIN

MODIFIED BITUMEN GRANULE SURFACED CAP SHEET BASE AND INTERPLY SHEETS AS REQUIRED

COVERBOARD (AS REQUIRED)

FIRESTONE INSULATION

SUBSTRATE

NOTES:

1. REFER TO FIRESTONE WEBSITE FOR MOST CURRENT INFORMATION.
2. A DRAIN INSERT IS RECOMMENDED WHEN DRAIN SUMP EXCEEDS 1:12.
3. THE HOLE IN THE TARGET PATCH SHOULD EXTEND A MINIMUM OF 1" (25 mm) INSIDE THE CLAMPING RING AND SHOULD NOT BE SMALLER THAN THE DIAMETER OF THE LEADER PIPE. FOR OPTIMAL RESULTS, EMBED GRANULES ON CAP SHEET PRIOR TO APPLYING ULTRAFLASH LIQUID FLASHING.
4. BOTH ULTRAFLASH ONE-PART AND TWO-PART LIQUID FLASHING SHOULD BE APPLIED WITH A BOTTOM COAT, EMBEDMENT COAT, AND FINISH COAT OF 30 MILS WET THICKNESS EACH.
5. ULTRAFLASH ONE-PART LIQUID FLASHING MAY BE USED ON SBS, APP, OR BUR SYSTEMS (UP TO 20-YR WARRANTY). ULTRAFLASH TWO-PART LIQUID FLASHING MAY ONLY BE USED ON SBS SYSTEMS (UP TO 30-YR WARRANTY).
7. ALL MATERIAL AND INSTALLATION REQUIREMENTS FOR SBS PLATINUM WARRANTY MUST BE FOLLOWED TO BE ELIGIBLE FOR 30 YEAR PLATINUM WARRANTY.
8. WHEN USING ULTRAFLASH TWO-PART LIQUID FLASHING, APPLY ULTRAFLASH LVOC PRIMER TO ALL NON-POROUS SURFACES.