






CUSTOM CURB TYPES	
 CLOSED - BEST FOR NEW CONSTRUCTION W/ CONSISTENT SIZED CURB	 2 PIECES - BEST FOR CONSISTENT SIZED CURBS W/ EXISTING EQUIPMENT
 1 PIECE - BEST FOR CONSISTENT SIZED CURBS W/ EXISTING EQUIPMENT	 4 PIECES - BEST FOR VARIABLE SIZED CURBS FOR MAXIMUM ADJUSTMENT

NOTES:

1. REFER TO FIRESTONE WEBSITE FOR MOST CURRENT INFORMATION.
2. ULTRAPLY TPO CUSTOM CURB FLASHING COMES IN CUSTOM SIZES TO FIT SPECIFIC CURB SIZES.
3. REFER TO DETAIL UT-LS-2 FOR WELD.
4. BONDING ADHESIVE IS REQUIRED BETWEEN CURB AND ULTRAPLY TPO CUSTOM CURB FLASHING IN FULLY ADHERED SYSTEMS WHEN THE MEMBRANE CAN NOT BE ATTACHED "UP & OVER" THE CURB, OR CURBS WHICH ARE GREATER THAN 12" (300 mm.) IN HEIGHT.
5. CUT EDGE SEALANT SHALL BE APPLIED TO ANY EDGES WHERE SCRIM REINFORCEMENT IS EXPOSED PER DETAIL UT-LS-14.
6. VERTICAL T-JOINT COVERS REQUIRED AT ALL VERTICAL TRANSITIONS ON NON-FACTORY WELDS.
7. FIELD T-JOINT COVERS ARE REQUIRED AT EACH T-JOINT WHERE THE FLASHING MEETS THE TPO FIELD MEMBRANE. FIELD T-JOINT COVERS ARE NOT REQUIRED WHEN 45 MIL. CURB FLASHINGS ARE USED.

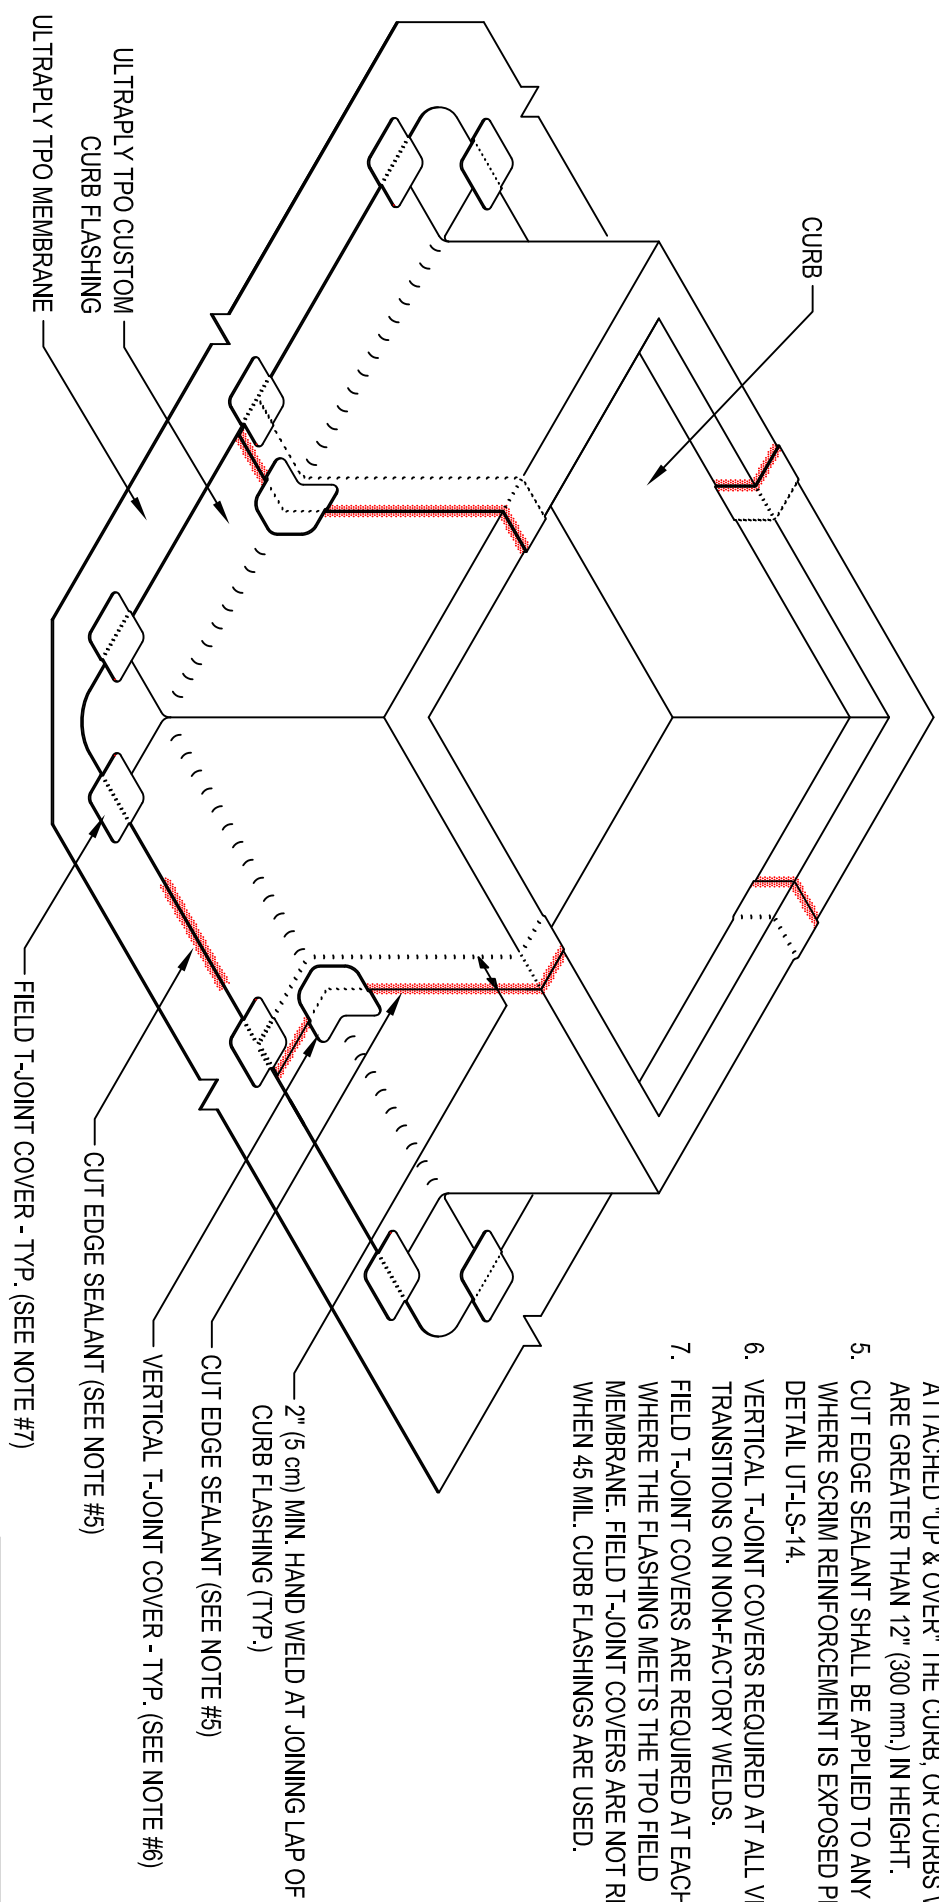

MAXIMUM WARRANTY: 20 YEARS

Firestone
BUILDING PRODUCTS
NOBODY COVERS YOU BETTER.™
 www.firestonebpco.com

CURB WITH ULTRAPLY TPO CUSTOM CURB FLASHING
 ULTRAPLY™ TPO
 ACCEPTABLE SYSTEMS: ALL

ISSUE / REVISION
 DATE: 7/01/2014
 NOT TO SCALE
DETAIL NO. UT-C-11