


THIS DETAIL IS NOT ACCEPTABLE FOR PAVEMENT OR BALLAST SYSTEMS, CONTACT FIRESTONE ROOFING SOLUTIONS.

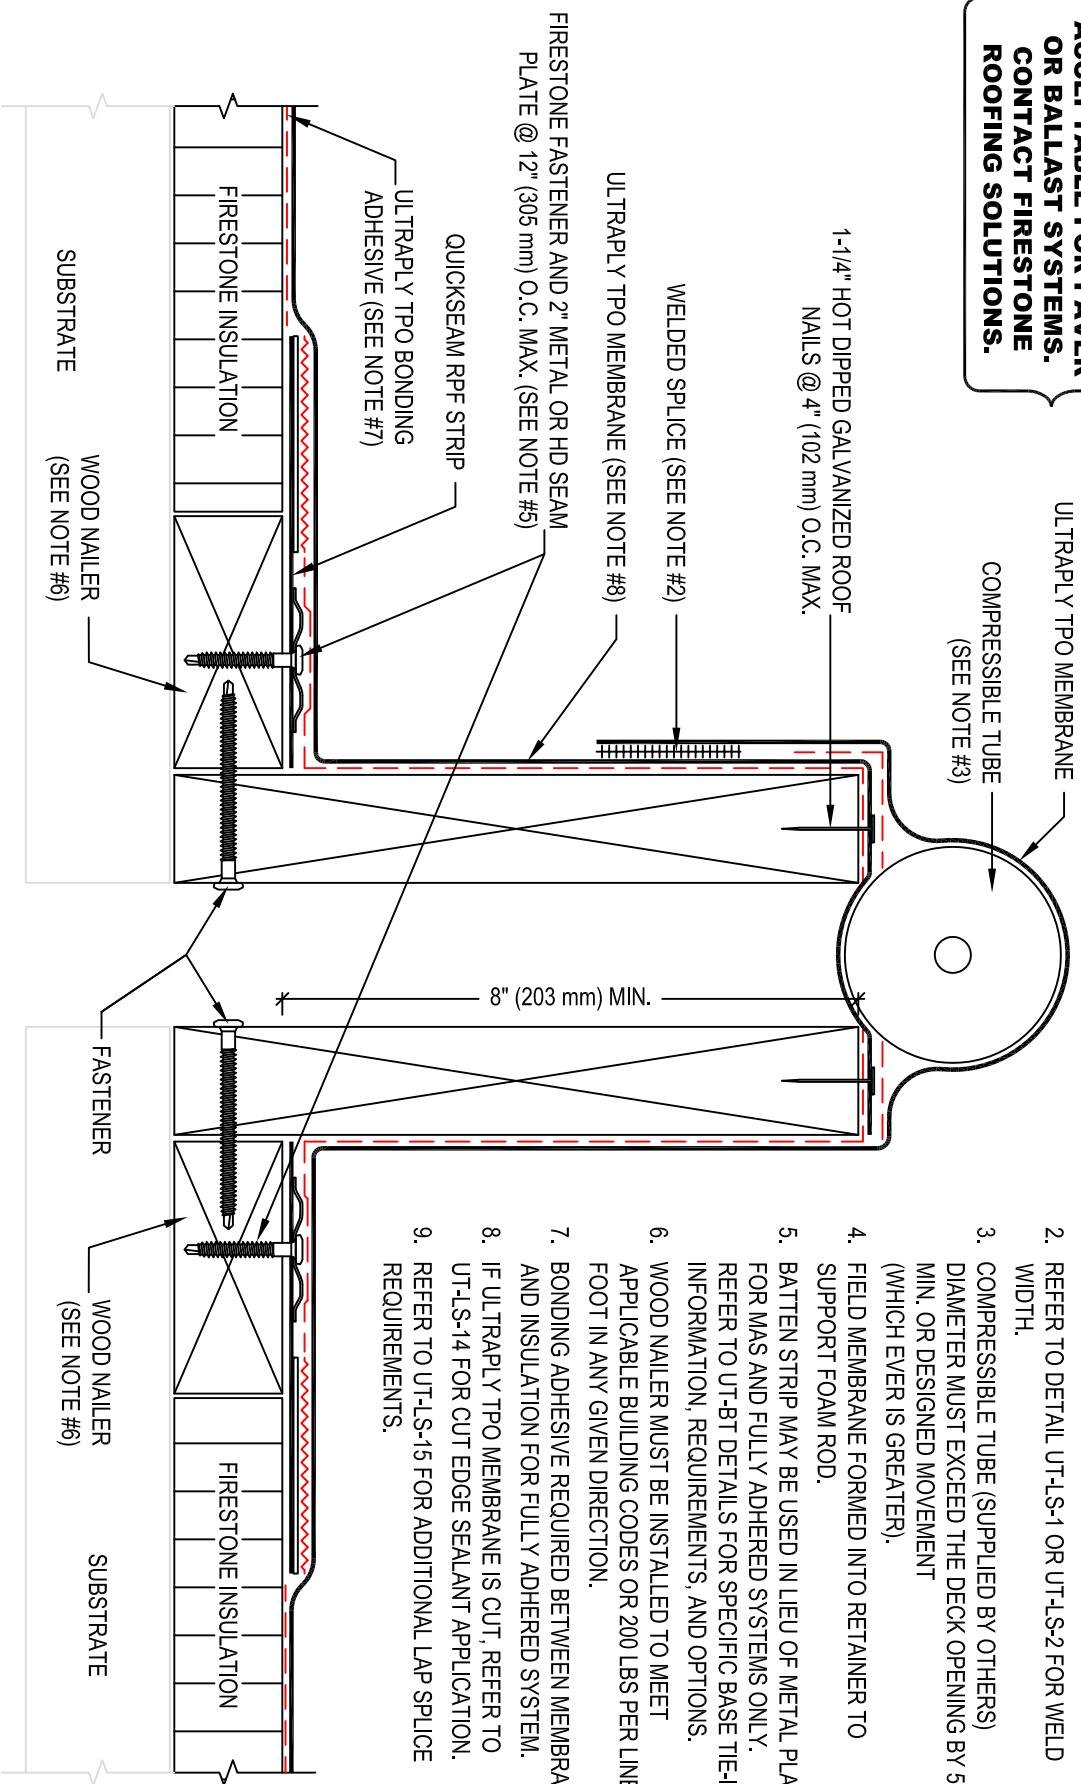

- NOTES:
1. REFER TO FIRESTONE WEBSITE FOR MOST CURRENT INFORMATION.
 2. REFER TO DETAIL UT-LS-1 OR UT-LS-2 FOR WELD WIDTH.
 3. COMPRESSIBLE TUBE (SUPPLIED BY OTHERS) DIAMETER MUST EXCEED THE DECK OPENING BY 50% MIN. OR DESIGNED MOVEMENT (WHICH EVER IS GREATER).
 4. FIELD MEMBRANE FORMED INTO RETAINER TO SUPPORT FOAM ROD.
 5. BATTEN STRIP MAY BE USED IN LIEU OF METAL PLATES FOR MAS AND FULLY ADHERED SYSTEMS ONLY. REFER TO UT-BT DETAILS FOR SPECIFIC BASE TIE-IN INFORMATION, REQUIREMENTS, AND OPTIONS.
 6. WOOD NAILER MUST BE INSTALLED TO MEET APPLICABLE BUILDING CODES OR 200 LBS PER LINEAR FOOT IN ANY GIVEN DIRECTION.
 7. BONDING ADHESIVE REQUIRED BETWEEN MEMBRANE AND INSULATION FOR FULLY ADHERED SYSTEM.
 8. IF ULTRAPLY TPO MEMBRANE IS CUT, REFER TO UT-LS-14 FOR CUT EDGE SEALANT APPLICATION.
 9. REFER TO UT-LS-15 FOR ADDITIONAL LAP SPLICE REQUIREMENTS.

Firestone
 BUILDING PRODUCTS
 NOBODY COVERS YOU BETTER.™
 www.firestonebpc.com

EXPANSION JOINT (FIELD FABRICATED) WITH QUICKSEAM RPF TO CURB
 ULTRAPLY™ TPO ACCEPTABLE SYSTEMS: ALL

ISSUE / REVISION DATE:
 7/22/2014

MAXIMUM WARRANTY: **20 YEARS**
 DETAIL NO. **UT-E-9**
 NOT TO SCALE