


USE APPROPRIATE TERMINATION

WELDED SPlice AT CURB OR WALL SEAM (SEE NOTE #2 & #5)

USE APPROPRIATE BASE TIE-IN DETAIL

- NOTES:
1. REFER TO FIRESTONE WEBSITE FOR MOST CURRENT INFORMATION.
 2. REFER TO DETAIL UT-LS-1, UT-LS-2, OR UT-LS-3 FOR WELD WIDTH.
 3. T-JOINT COVER REQUIRED FOR .060 GAUGE MEMBRANE ONLY.
 4. ULTRAPLY TPO FLASHING (UNSUPPORTED) (4x4" MIN. ROUNDED CORNERS) MAY BE USED IN LIEU OF T-JOINT CORNERS.
 5. WHEN REINFORCEMENT OF TPO MEMBRANE IS EXPOSED, REFER TO UT-LS-14 FOR CUT EDGE SEALANT APPLICATION.

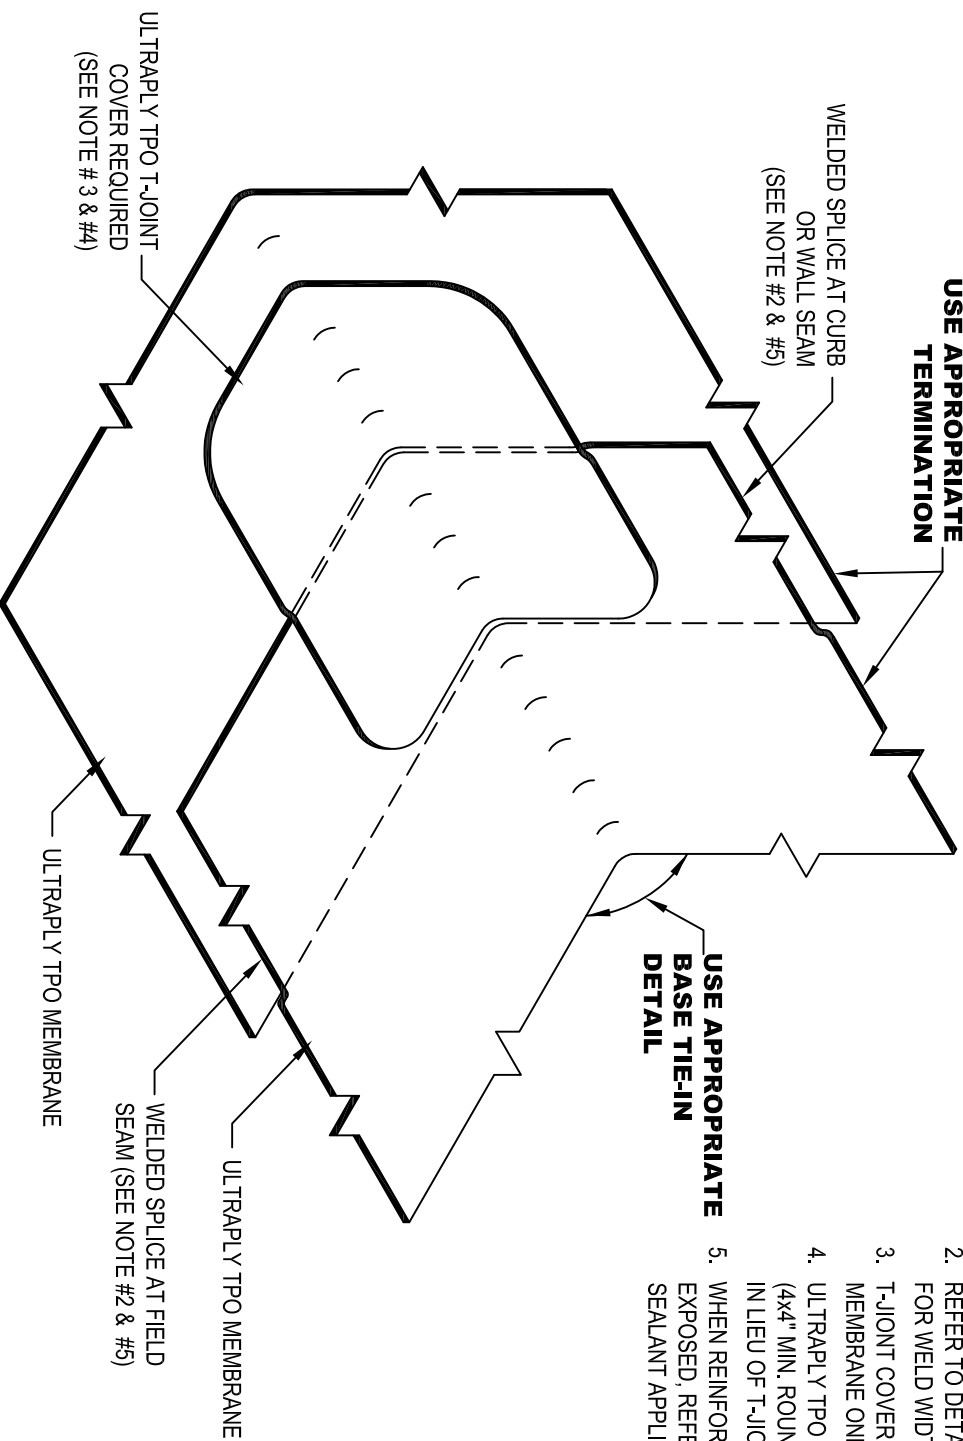

MAXIMUM WARRANTY: **20 YEARS**

LAP SPlice AT FIELD TO CURB / WALL FLASHING

TRANSITION USING T-JOINT COVER

ULTRAPLY™ TPO

ACCEPTABLE SYSTEMS: ALL

ISSUE / REVISION DATE:

6/24/2014

NOT TO SCALE

DETAIL NO.

UT-LS-13

Firestone

BUILDING PRODUCTS

NOBODY COVERS YOU BETTER.™

www.firestoneppco.com