
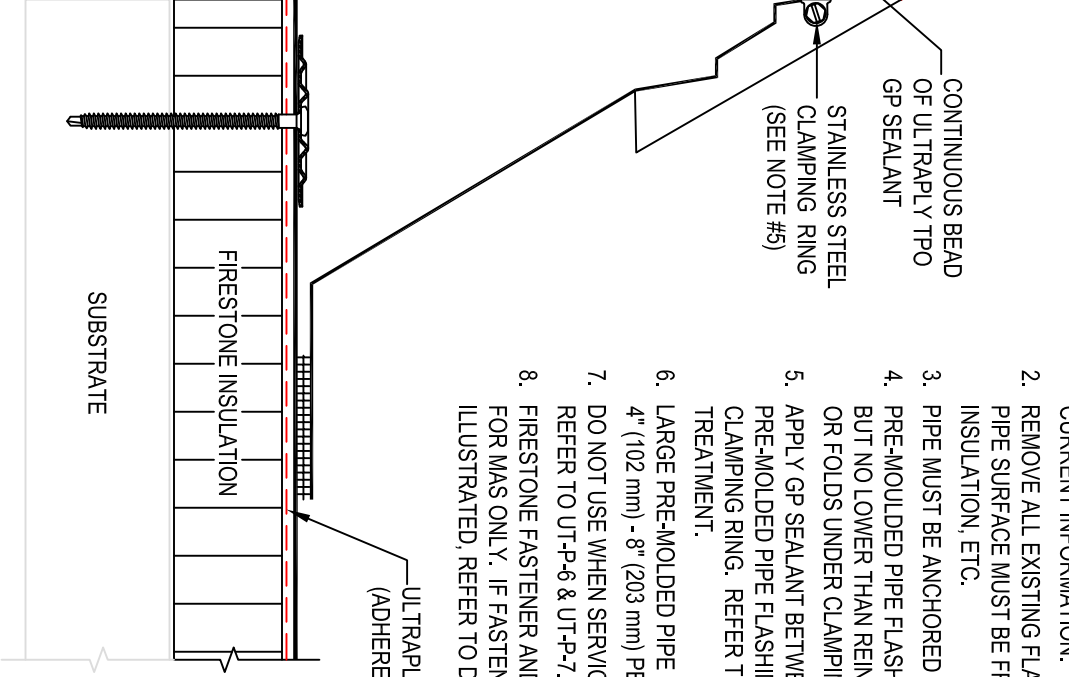


**PLAN VIEW
PIPE FLASHING OVER
FIELD SEAM**

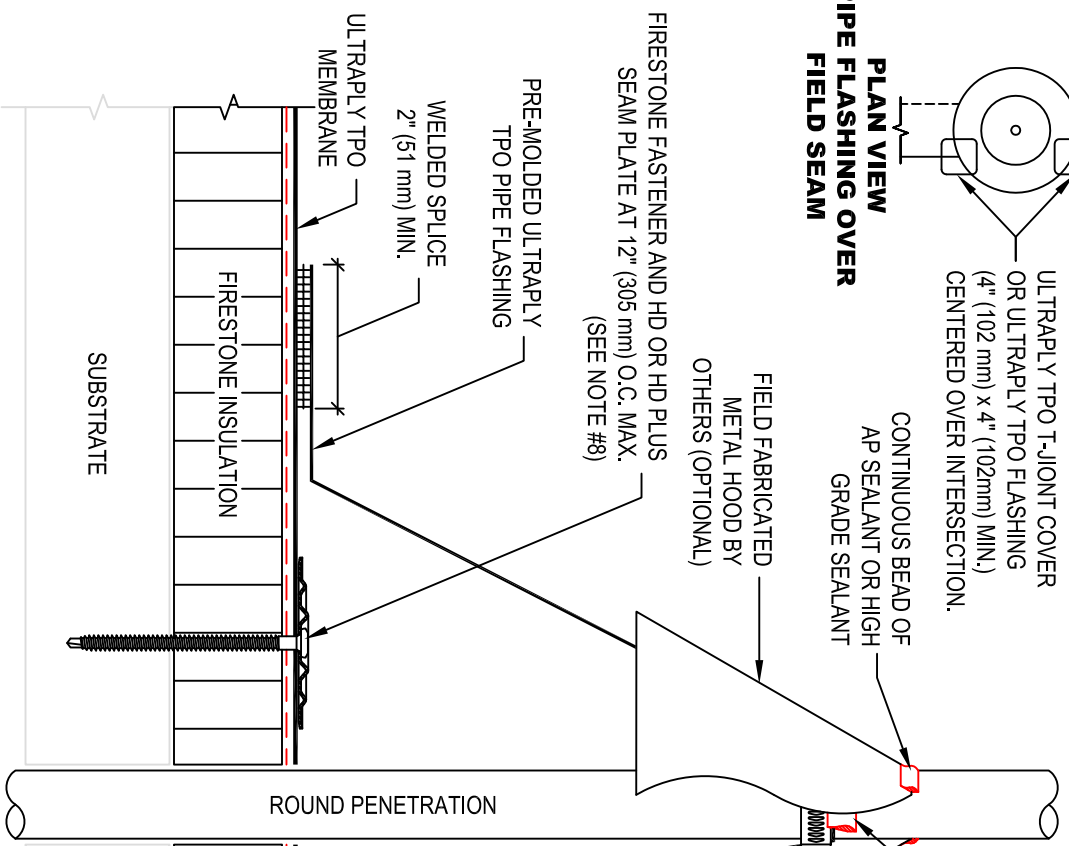

ULTRAPLY TPO T-JOINT COVER
OR ULTRAPLY TPO FLASHING
(4" (102 mm) x 4" (102mm) MIN.)
CENTERED OVER INTERSECTION.

CONTINUOUS BEAD OF
AP SEALANT OR HIGH
GRADE SEALANT

FIELD FABRICATED
METAL HOOD BY
OTHERS (OPTIONAL)

CONTINUOUS BEAD
OF ULTRAPLY TPO
GP SEALANT

STAINLESS STEEL
CLAMPING RING
(SEE NOTE #5)

ULTRAPLY TPO BONDING ADHESIVE
(ADHERED SYSTEM ONLY)

- NOTES:
1. REFER TO FIRESTONE WEBSITE FOR THE MOST CURRENT INFORMATION.
 2. REMOVE ALL EXISTING FLASHING, LEAD, ETC. PIPE SURFACE MUST BE FREE OF ALL RUST, GREASE, INSULATION, ETC.
 3. PIPE MUST BE ANCHORED TO ENSURE STABILITY.
 4. PRE-MOLDED PIPE FLASHING MAY BE CUT TO HEIGHT, BUT NO LOWER THAN REINFORCING RING (NO WRINKLES OR FOLDS UNDER CLAMPING RING).
 5. APPLY GP SEALANT BETWEEN PENETRATION AND PRE-MOLDED PIPE FLASHING PRIOR TO INSTALLATION OF CLAMPING RING. REFER TO LS-9 FOR SEAM EDGE TREATMENT.
 6. LARGE PRE-MOLDED PIPE FLASHING FITS 4" (102 mm) - 8" (203 mm) PENETRATIONS SIZES.
 7. DO NOT USE WHEN SERVICE LINE TEMP. EXCEEDS 160°F. REFER TO UT-P-6 & UT-P-7.
 8. FIRESTONE FASTENER AND HD SEAM PLATE REQUIRE FOR MAS ONLY. IF FASTENER CANNOT BE INSTALLED AS ILLUSTRATED, REFER TO DETAILS UT-P-15 & UT-P-16

PENETRATION WITH ULTRAPLY TPO SMALL PIPE FLASHING

ULTRAPLY™ TPO

ACCEPTABLE SYSTEMS: ALL

MAXIMUM WARRANTY: **20 YEARS**

ISSUE / REVISION
DATE:
10/26/2013

DETAIL NO.
UT-P-2

NOT TO SCALE