


SIZE TABLE		
SIZE	OUTSIDE DIAMETER OF PIPE	STARTING HEIGHT
SMALL	1.0" to 3.0" (25 mm to 76 mm)	9.0" (229 mm)
MEDIUM	3.0" to 5.5" (76 mm to 140 mm)	8.5" (216 mm)
LARGE	5.5" to 8.0" (140 mm to 203 mm)	8.75" (222 mm)

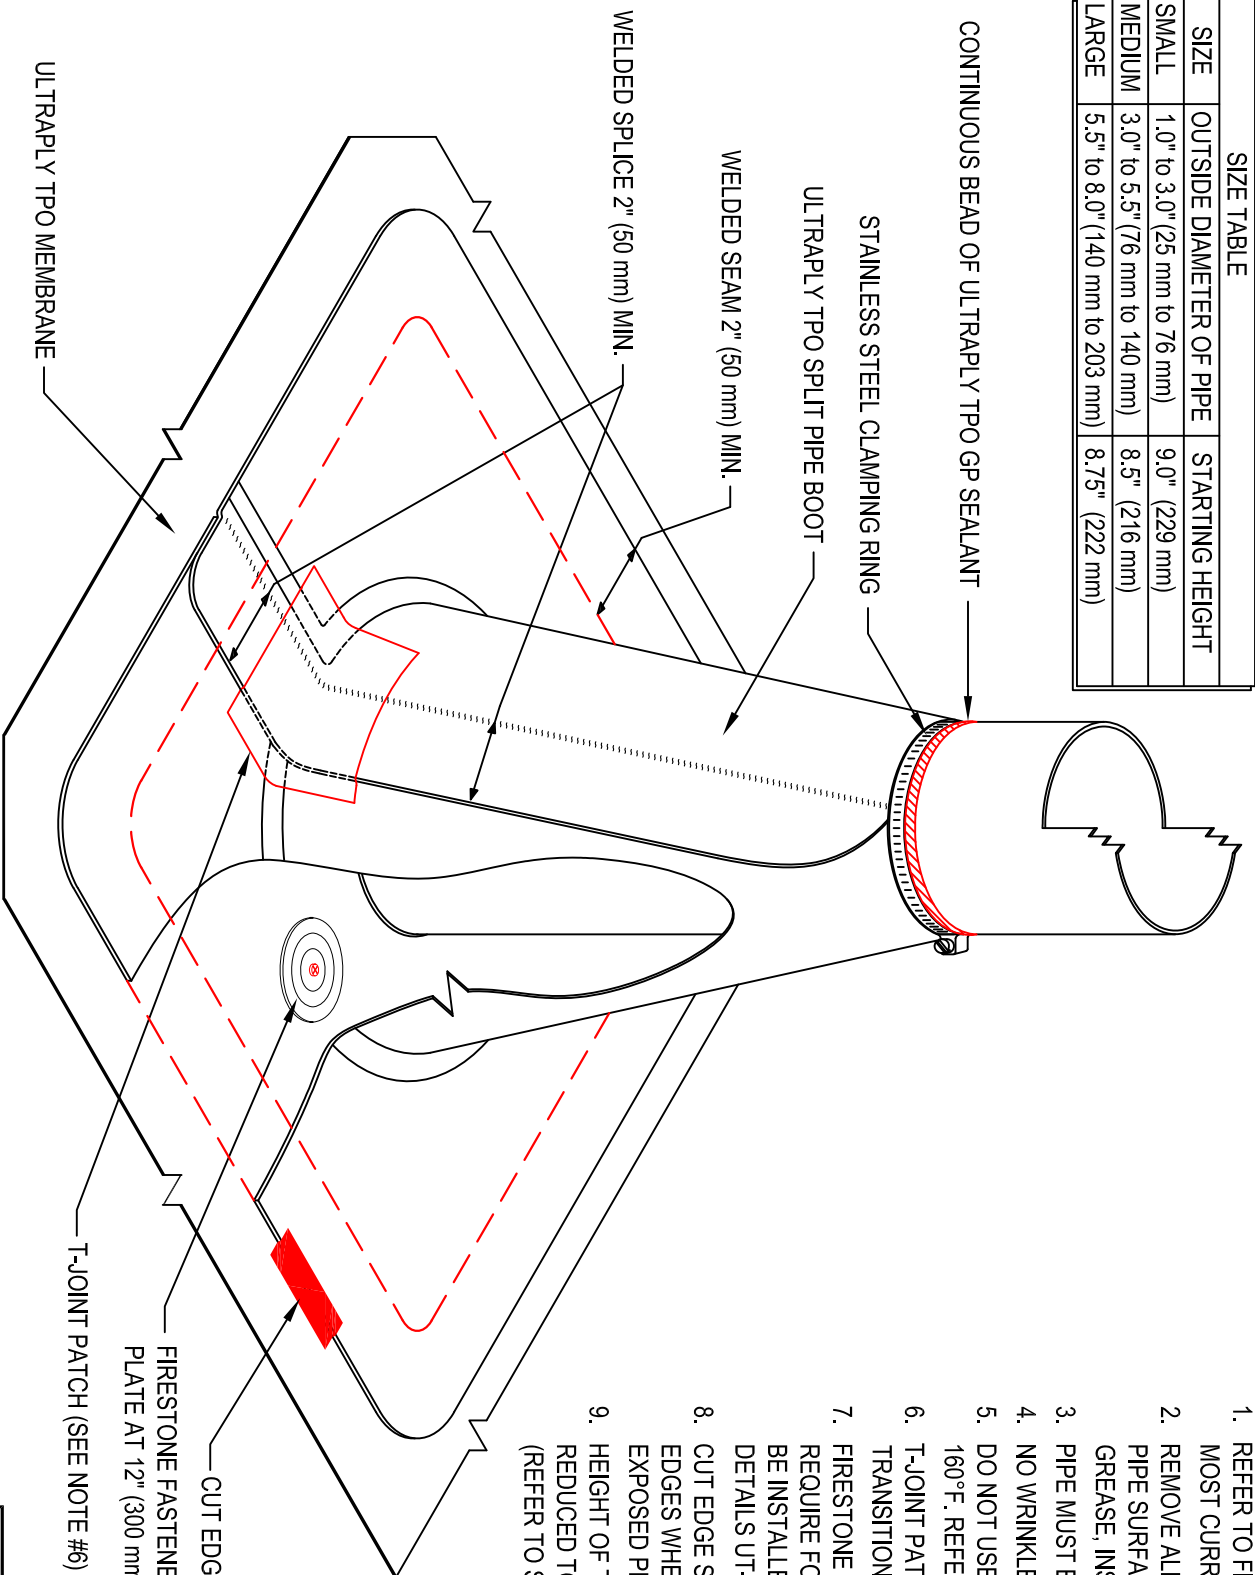

- NOTES:
1. REFER TO FIRESTONE WEBSITE FOR THE MOST CURRENT INFORMATION.
 2. REMOVE ALL EXISTING FLASHING, LEAD, ETC. PIPE SURFACE MUST BE FREE OF ALL RUST, GREASE, INSULATION, ETC.
 3. PIPE MUST BE ANCHORED TO ENSURE STABILITY.
 4. NO WRINKLES OR FOLDS UNDER CLAMPING RING.
 5. DO NOT USE WHEN SERVICE LINE TEMP. EXCEEDS 160°F. REFER TO UT-P-6 & UT-P-7.
 6. T-JOINT PATCH REQUIRED AT ALL VERTICAL TRANSITIONS ON NON-FACTORY WELDS.
 7. FIRESTONE FASTENER AND HD SEAM PLATE REQUIRE FOR MAS ONLY. IF FASTENER CANNOT BE INSTALLED AS ILLUSTRATED, REFER TO DETAILS UT-P-15 & UT-P-16
 8. CUT EDGE SEALANT SHALL BE APPLIED TO ANY EDGES WHERE SCRIM REINFORCEMENTS IS EXPOSED PER DETAIL UT-LS-14.
 9. HEIGHT OF TPO SPLIT PIPE BOOT CAN BE REDUCED TO FIT LARGER DIAMETER PIPES. (REFER TO SIZE TABLE).

MAXIMUM WARRANTY: **20 YEARS**